

Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 1 of 61	

Company: CNOOC IRAQ LIMITED

Project: WATER INJECTION STATIONS EXPANSION PROJECT

Company's Doc. No.: CMIT-230084-1-796-PIP-15.03-00-2011

Unit Name: ` GENERAL

PIP

Prepared by: \(\frac{1}{20250429}\)

Checked by: Ma X.R. 20250429

Approved by: (ui) Qi 20250429

0	ISSUED FOR CONSTRUCTION	Liu Xinyu	Ma Xiangrong	Cui Qi	20250429
С	ISSUED FOR APPROVAL	Liu Xinyu	Ma Xiangrong	Cui Qi	20250418
В	ISSUED FOR APPROVAL	Liu Xinyu	Ma Xiangrong	Cui Qi	20250306
Α	ISSUED FOR REVIEW	Liu Xinyu	Ma Xiangrong	Cui Qi	20250108
Rev.	Description	PRED.	CHKD.	APPR.	Date



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 2 of 61

#### **TABLE OF CONTENTS**

1. GENERAL	3
2. CODES, REGULATIONS, STANDARDS	5
3. GENERAL	11
4. PIPE	12
5. VALVES	13
6. FLANGES	15
7. FITTINGS	15
8. BOLTING	16
9. GASKETS	16
10. NON METALLIC MATERIAL	17
11. SOUR SERVICE PIPING	17
12. PIPING CLASSIFICATIONS AND MATERIAL SPECIFICATIONS	18
APPENDIX A	23
APPENDIX B	25
APPENDIX C	56
APPENDIX D	60



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 3 of 61

#### 1. GENERAL

MISSAN Oil Field is located in the SE of Iraq, close to Iran's border, about 175 km N-NW of BASRA City, and 350 km SE of Baghdad – the capital of Iraq.

MISSAN Oil Field includes three producing fields namely Abu GHIRAB, BUZURGAN and FAUQI. Abu GHIRAB and FAUQI fields extend beyond the Iranian border.

Since MISSAN Oil Field was built in 1976, it has suffered from the Iran-Iraq War and the Iraq War, so a lot of facilities needs to be upgraded and revamped.

The intended project is mainly concerned for the Water Injection Station(s) Expansion in Three Locations namely BUN, FQS and BUS3.

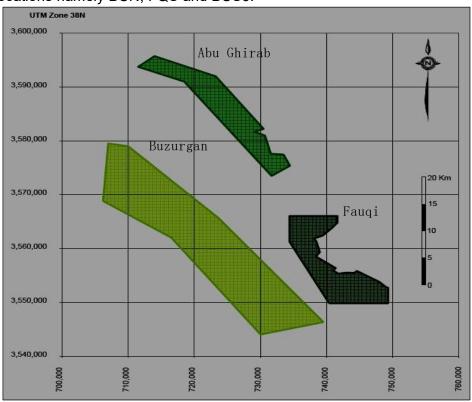


Figure 1.1-1 The overall MISSAN Oil Field

General Field Layout is shown in below figure:



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 4 of 61

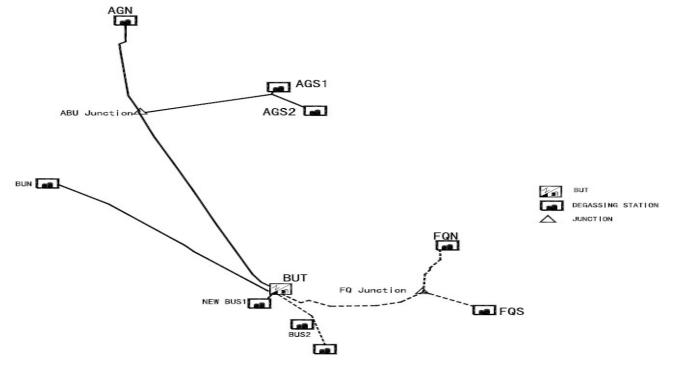


Figure 1.1-2 General Field Layout

#### 1.1. Water Injection Stations (WIS):

A newly-established Water Injection Station are located at BUN, BUS3 and FQS areas adjacent to the newly-established Degassing Stations built therein.

On the three stations, the established Water Injection Stations and the Degassing Stations have been completed since 2021.

BUN Water Injection Stations (WIS) have been equipped with Two Water Storage Tanks, Three Water Feed Pumps, Three Water Injection Pumps, Water Injection Manifold that delivering the pressurized water to its intended manifold or/and well.

FQS Water Injection Station has been equipped with Two Water Storage Tanks, One Water Feed Pump, One Water Injection Pump, Water Injection Manifold that delivering the pressurized water to its intended manifold or/and well.

BUS3 Water Injection Station has been equipped with Two Water Storage Tanks, Two Water Feed Pumps, Two Water Injection Pumps, Water Injection Manifold that delivering the pressurized water to its intended manifold or/and well.

In this project, those three Water Injection Stations will be expanded.



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 5 of 61	

#### 1.2. Abbreviation and Acronyms

The following definitions shall apply to this document:

**COMPANY: CNOOC IRAQ LIMITED** 

**PMC**:Project Management Consultant

**CONTRACTOR**: CNOOC Petrochemical Engineering Co.,Ltd (COPCL or CNOOCPEC).

**WIS**:Water Injection Station

**WTP**:Water Treatment Plant (Oily Water Treatment)

**WIP**:Water Injection Pump

**DGS** or **DS**: Degassing Station

**BUT**: BUZURGAN CPF Terminal

#### 1.3. Scope

This specification governs the selection and limitations of piping and piping system components in the WATER INJECTION STATIONS which belongs to the scope of ASME B31.3. This section should be read in conjunction with associated specifications of this project and most stringent shall be followed when conflicts. The design of wellheads and flowlines is not included in the scope of work.

#### 2. CODES, REGULATIONS, STANDARDS

#### 2.1. Codes and Standards

Vendor shall meet or exceed the requirements of the latest edition or the equivalent ones of the following codes, regulations and standards, except as superseded herein. In cases where more than one code, regulation or standard apply to the same condition, the most stringent shall be followed. In the event of a conflict between this specification and other specifications or correspondence, the COMPANY shall be consulted and a ruling, in writing, shall be obtained before any work is started.

The documents will not be copied, forwarded, disclosed or used for other purposes without permission of CNOOCPEC!



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 6 of 61

#### **ASME Standards**

ASME B1.1	Unified Inch Screw Threads (UN and UNR Thread Form)
ASME B1.20.1	Pipe Threads, General Purpose (Inch)
ASME B16.5	Pipe Flanges and Flanged Fittings NPS 1/2 Through NPS 24 Metric/Inch Standard
ASME B16.9	Factory-Made Wrought Buttwelding Fittings
ASME B16.10	Face-to-Face and End-to-End Dimensions of Valves
ASME B16.11	Forged Fittings, Socket-Welding and Threaded
ASME B16.20	Metallic Gaskets for Pipe Flanges
ASME B16.21	Non-metallic Flat Gaskets for Pipe Flanges
ASME B16.34	Valves - Flanged, Threaded, and Welding End
ASME B16.36	Orifice Flanges
ASME B16.47	Large Diameter Steel Flanges NPS 26 Through NPS 60 Metric/Inch Standard
ASME B16.48	Line Blanks
ASME B18.2.2	Nuts for General Applications: Machine Screw Nuts, Hex, Square, Hex Flange, and Coupling Nuts (Inch Series)
ASME B18.31.2	Continuous Thread Stud, Double-End Stud, and Flange Bolting Stud (Stud Bolt) (Inch Series)
ASME B31.3	Process Piping
ASME B31.4	Pipeline Transportation Systems for Liquids and Slurries
ASME B36.10	Welded and Seamless Wrought Steel Pipe
ASME B36.19	Stainless Steel Pipe

#### **ASTM Standards**

ASTM A105/	Standard Specification for Carbon Steel Forgings for Piping
A105M	Applications



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 7 of 61

	7
ASTM A106/ A106M	Standard Specification for Seamless Carbon Steel Pipe for High-Temperature Service
ASTM A182/ A182M	Standard Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service
ASTM A193/ A193M	Standard Specification for Alloy-Steel and Stainless Steel Bolting for High Temperature or High Pressure Service and Other Special Purpose Applications
ASTM A194/ A194M	Standard Specification for Carbon Steel, Alloy Steel, and Stainless Steel Nuts for Bolts for High Pressure or High Temperature Service, or Both
ASTM A234/ A234M	Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service
ASTM A312/ A312M	Standard Specification for Seamless, Welded, and Heavily Cold Worked Austenitic Stainless Steel Pipes
ASTM A403/ A403M	Standard Specification for Wrought Austenitic Stainless Steel Piping Fittings
ASTM A790/ A790M	Standard Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Pipe
ASTM A815/ A815M	Standard Specification for Wrought Ferritic, Ferritic/Austenitic, and Martensitic Stainless Steel Piping Fittings
ASTM A928/ A928M	Standard Specification for Ferritic/Austenitic (Duplex) Stainless Steel Pipe Electric Fusion Welded with Addition of Filler Metal

#### **API Standards**

API SPEC 5L	Line Pipe
API STD 600	Steel Gate Valves - Flanged and Butt-welding Ends, Bolted Bonnets
API STD 602	Gate, Globe, and Check Valves for Sizes DN 100 (NPS 4) and
API 51D 002	Smaller for the Petroleum and Natural Gas Industries



Job No.	243007D0796	
Doc. No.	MP00S	311
Phase	DETAILED DESIGN	
Rev.	0	Page 8 of 61

API STD 607	Fire Test for Quarter-turn Valves and Valves Equipped with Nonmetallic Seats
API STD 608	Metal Ball Valves - Flanged, Threaded, and Welding Ends
API STD 609	Butterfly Valves: Double-Flanged, Lug-and Wafer-type
API STD 623	Steel Globe Valves-Flanged and Buttwelding Ends, Bolted Bonnets
API STD 594	Check Valves: Flanged, Lug, Wafer, Butt-welding
API STD 598	Valve Inspection and Testing
API SPEC 6FA	Specification for Fire Test for Valves
API SPEC 6D	Specification for Valves
API SPEC 15LR	Specification for Low Pressure Fiberglass Line Pipe and Fittings
API SPEC 15LE	Specification for Polyethylene Line Pipe (PE)

#### MSS-SP Standards

MSS SP-25	Standard Marking System for Valves, Fittings, Flanges and Unions
MSS SP-43	Wrought and Fabricated Butt-Welding Fittings for Low Pressure, Corrosion Resistant Applications
MSS SP-75	High-Strength, Wrought, Butt-Welding Fittings
MSS SP-83	Class 3000 and 6000 Pipe Unions, Socket Welding and Threaded
MSS SP-95	Swage(d) Nipples and Bull Plugs
MSS SP-97	Integrally Reinforced Forged Branch Outlet Fittings-Socket Welding, Threaded, and Buttwelding Ends

#### NACE Standards

NACE MR0175 / ISO 15156	Petroleum and Natural Gas Industries - Materials for Use in H <sub>2</sub> S-containing Environments in Oil and Gas Production
NACE MR0103 / ISO 17945	Petroleum, Petrochemical and Natural Gas Industries - Metallic  Materials Resistant to Sulfide Stress Cracking in Corrosive  Petroleum Refining Environments



Job No.	243007D0796	
Doc. No.	MP00S	311
Phase	DETAILED DESIGN	
Rev.	0	Page 9 of 61

NACE TM0177	Laboratory Testing of Metals for Resistance to Sulfide Stress Cracking and Stress Corrosion Cracking in H <sub>2</sub> S Environments
NACE TM0284	Evaluation of Pipeline and Pressure Vessel Steels for Resistance to Hydrogen-Induced Cracking

#### **ISO Standards**

ISO 10497	Testing of Valves - Fire Type-Testing Requirements
ISO 15761	Steel Gate, Globe and Check Valves for Sizes DN 100 and Smaller, for the Petroleum and Natural Gas Industries
ISO 17292	Metal Ball Valves for Petroleum, Petrochemical and Allied Industries
ISO 5208	Industrial Valves - Pressure Testing of Metallic Valves

#### **BS Standards**

BS EN 10204	Metallic Products - Types of Inspection Documents
BS EN 12266	Industrial Valves - Testing of Metallic Valves

Note: This list covers the majority of references, but it is not exhaustive.

#### 2.2. Reference Documents

The following General Specifications shall be used in conjunction with this specification where applicable:

CMIT-230084-1-796-PCS-15.65-00-0001	DESIGN BASIS
CMIT-230084-1-796-PIP-15.03-00-2010	SPECIFICATION FOR MANUAL VALVES
CMIT-230084-1-796-PIP-15.06-00-2001	PIPE WALL THICKNESS CALCULATION REPORT
CMIT-230084-1-796-PIP-15.70-00-2001	MATERIAL SELECTION REPORT
CMIT-230084-1-796-PIP-15.03-00-2012	SPECIFICATION FOR A106 GR.B SEAMLESS PIPING MATERIAL IN SOUR SERVICE
CMIT-230084-1-796-PIP-15.03-00-2013	SPECIFICATION FOR A105N FORGINGS



Job No.	243007D0796	
Doc. No.	MP00S	311
Phase	DETAILED DESIGN	
Rev.	0	Page 10 of 61

	MATERIAL IN SOUR SERVICE
CMIT-230084-1-796-PIP-15.03-00-2014	SPECIFICATION FOR A234 GR.WPB FITTING MATERIAL IN SOUR SERVICE
CMIT-230084-1-796-PIP-15.03-00-2015	SPECIFICATION FOR GRE PIPING MATERIAL
CMIT-230084-1-796-PIP-15.03-00-2016	SPECIFICATION FOR DUPLEX STAINLESS STEEL S31803 PIPING MATERIAL
CMIT-230084-1-796-PIP-15.03-00-2017	SPECIFICATION FOR FITTINGS AND FLANGES

Some requirements in this specification may be modified by specific requirements in the Purchase Specification. In case of conflict, the specific requirements supersede this specification.

Any deviation from this specification must be approved, in writing, by COMPANY. Such written approval must be obtained prior to the commencement of any work which would constitute such a deviation.

#### 2.3. Order of Precedence

All conflicts between the requirements of this specification, related contract documents national/ international documents, codes, engineering practices and the requisition shall be referred to COMPANY/CONTRACTOR for clarification. Should any conflict occur in the application of these specifications, the order of precedence shall be as follows:

- 1) Iraqi Laws and Regulations;
- 2) PURCHASE Order (including attachments) and variations thereon;
- 3) Data sheets and drawings;
- 4) This Technical Specification;
- 5) Project Specification in conjunction with native standard;
- 6) International codes and standards.



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 11 of 61

#### 3. GENERAL

- 3.1 All pressures given in this Specification are gauge pressure unless specially noted.
- 3.2 Except under special conditions of severity, hazard, etc., the materials used shall be in accordance with the Piping Materials Specification which is based on the design pressure and temperature and on the type of service. The materials used under special conditions of severity and hazard must be suitable for the particular service conditions involved.
- 3.3 The corrosion allowance specified for the classes shall be considered in the calculation of the wall thickness.
- 3.4 In no case it shall be reduced to obtain a thinner commercially available pipe thickness.
- 3.5 The abbreviated material description in the classes gives brief information to the piping designer. For the supply of the material, detailed technical requirements shall be included in the purchasing requisitions.
- 3.6 All material used shall be selected in accordance with code requirements and industry standards for good workmanship.
- 3.7 Pipe materials shall be selected as follows, whenever temperature is the governing factor.

Material Temperature Range

Carbon Steel -29°C to 425°C

Low alloys (carbon-moly and chrome alloys) -40°C to 450°C

Austenite Stainless Steel -98°C to 450°C

Other types of materials or alloys shall be used where corrosive conditions are the governing factor. NACE MR 0175/ISO 15156 shall be used for selecting and treating of materials for piping in sour services.

- 3.8 The use of any materials containing asbestos is prohibited.
- 3.9 All piping materials shall meet the impact requirements of ASME B31.3. When Charpy V-notch testing is a requirement, it shall be conducted in accordance with ASTM Standard A370 below the minimum design temperature.



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 12 of 61

3.10 Marking for pipe and fittings shall be done as per relevant piping standard, and shall include the following,

The size

Pipe schedule/wall thickness

The specification and grade of material

The heat number

The batch number

On ferrous material with a thickness under 5mm (austenitic steels under 10mm), marking shall be applied by engraving or by stenciling. For stencil marking, a water insoluble ink shall be used, that does not contain substances which could harmfully affect the material.

On ferrous material with a thickness 5mm & over (austenitic steels 10mm & over), marking shall be applied by low stress hard die stamping. Low stress stamps shall have a round nose with a radius of minimum 0.25mm.

#### 4. PIPE

- 4.1 Pipe shall normally be as specified in the Specification for Piping Materials for the applicable Piping Class Rating and Service.
- 4.2 Piping for service below -29°C and above 454°C shall be approved in writing by COMPANY.
- 4.3 Material ASTM A106 Gr. B (SSC&HIC) is for sour service. For chemical injection service, ASTM A 312-TP316L shall be used. For liquid sulphur, steam jacked carbon steel is used. For the other service material selection, please refers to Appendix B.
- 4.4 Marking and Finish

Pipe shall be legibly marked in accordance with the applicable ASTM or ISO specification.

- 4.5 Pipe sizes 1½", 3½", 5", 7", 9", 22", 26", 34", 38", 44" & 46" shall not be used. Line connections to equipment with such connections sizes should be made with suitable reducing fittings.
- 4.6 Galvanized piping (1G0)



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 13 of 61

These piping from air header to different field instruments shall be installed with the following considerations.

4.6.1 Threaded connections shall be done by the use of thread compound or P.T.F.E. (Teflon) tape. P.T.F.E. tape shall not be used where temperatures exceed 230°C (450°F).

Wherever thread compound is used on screwed fittings it should be applied to the male thread only.

- 4.6.2 All pipe ends shall be cut square, reamed of all burrs and cleared of all foreign material.
- 4.6.3 Cutting oil shall be used in cutting all threads on galvanized pipe.

#### 4.7 Hardness of Pipe Material

The maximum hardness of pipe with welded seams anywhere in the weld, heat-affected zone, or parent metal shall follow the requirements specified in latest edition of NACE MR 0175/ISO15156 or other applicable codes & standards and Section 11.0 hereinafter.

4.8 Schedules 5S shall not be used for stainless steels and schedule 80 shall be selected for carbon steel as a minimum for pipes 1½" diameter and below.

#### 5. VALVES

#### 5.1. GENERAL

Valves shall be provided in accordance with this specification and CMIT-230084-1-796-PIP -15.03-00-2010 SPECIFICATION FOR MANUAL VALVES.

No valves of brass, cast iron, ductile iron, nodular iron, or semi-steel; nor valves containing rubber, bronze or plastics shall be used unless specifically noted in the CMIT-230084-1-796-PIP-15.03-00-2010 SPECIFICATION FOR MANUAL VALVES.

Flanged valves shall be used in place of socket weld and screwed valves in 3/4" and 1 1/2" sizes when mounted directly to flanged connection, vent, drain and level control connection. Rating of valves must match nozzle connection.

Care shall be taken to maintain differential hardness between seats and ball/wedge/plug/disc in nickel based alloys to prevent galling.

All valves shall be of fire-safe design. Ball valves shall be fire-safe tested in accordance with API 607/API 6FA.



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 14 of 61

Gear operators shall be provided on valves as required in the CMIT-230084-1-796-PIP -15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.

Welded-end (butt welded) valves of any type (e.g., ball, gate, check, etc.) shall not be allowed without prior, specific written approval of COMPANY on a case by case basis. In this project, the heating medium system piping valve shall be welded-end. Detailed information refers to CMIT-230084-1-796-PIP-15.03-00-2010 SPECIFICATION FOR MANUAL VALVES.

All valves, excluding check valves unless specified otherwise, shall be provided with hand wheels, levers, wrenches or gear operators as required for the intended services, and shall be capable of sealing with design pressure applied from either end of the valve. All ball, check, gate and globe valves shall be field repairable. Balls, discs, flappers, seals and seats shall be replaceable without requiring welding or cutting.

In the absence of a specified test procedure, API 598, ISO5208, BS 6755 or API 6D shall be the basis for testing.

#### **5.2. VALVE IDENTIFICATION**

Each valve in a facility shall be designated by a descriptive valve identification number consisting of the following identifiers:

Nominal Valve Size (inches NPS)

Valve Type

Piping Class Code

Valve Style

S (NACE TAGGED)

E.G. 10"-BA-1A1-1S, specifies:

10" ----Nominal valve size.

BA -----Valve Type (Ball Valve).

1A1 -----Piping Class Code (See APPENDIX A)

1 -----Valve Sequence Number (See CMIT-230084-1-796-PIP-15.03-00-2010\_ SPECIFICATION FOR MANUAL VALVES)



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 15 of 61

S ----NACE Tagged.

Valve Type:

BA - Ball BT - Butterfly CK - Check GA - Gate GL - Globe PL-Plug

#### 6. FLANGES

- 6.1 Flanges shall be provided in accordance with this specification for the applicable Piping Class Rating and Service.
- 6.2 Flanges and flanged connections up to and including NPS 24" shall be in accordance with ASME B 16.5 and flanges 26" & above shall be in accordance with ASME B16.47 series "A" (formerly MSS SP 44) unless otherwise stated.
- 6.3 RF(less than 600#) and RJ (600# and above) are recommended for ease of fit up and installation and removal of valves and equipment with COMPANY approval. For Piping Class 1G0 (Galvanized), in place of socket welded & weld neck flanges, screwed (NPT) raised face flanges shall be used.
- 6.4 Spectacle blind shall be in accordance with ASME B16.48 & shall be suitable for installation between ASME B16.5 RF and RJ flanges.
- 6.5 Orifice flanges shall be supplied in pairs, complete with jackscrews for ease of removal. Quantities on bills-of-material, material requisitions, etc., shall indicate sets, not individual flanges.
- 6.6 All spec breaks (e.g. two different materials or different thicknesses) must be indicated at flanges.
- 6.7 Slip-on flanges (flat face) are permitted only for where connection is necessary between fiberglass flanges and steel flanges.

#### 7. FITTINGS

- 7.1 Fittings shall be provided in accordance with this specification for the applicable Piping Class Rating and Service.
- 7.2 Fittings shall conform to ASTM A234, ASTM A105, ASTM A182, ASTM A403 and as applicable.



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 16 of 61

- 7.3 For sour service, ASTM A105N and ASME A234 Gr.WPB(SSC&HIC) are chosen as material of fittings.
- 7.4 Branch Connections using welding tees or commercial integrally reinforced fittings such as Weldolets, or Threadolets are equally acceptable, with the choice of the type of connection based on the criteria provided by the Branch Connection Tables contained in Appendix C.
- 7.5 Butt weld elbows shall be long radius type (radius =  $1\frac{1}{2}$  nominal pipe size).
- 7.6 Fittings shall be prepared for shipment in a manner that damage or atmospheric corrosion of internal or external surfaces is avoid during storage and transport.
- 7.7 Fittings shall be marked in according with MSS SP-25.

#### 8. BOLTING

- 8.1 Flange bolting shall be provided suitable for connecting ASME B16.5/ASME B16.47 Series. A flanges in accordance with this specification for the applicable Piping Class Rating and Service.
- 8.2 Materials for use below -29°C and above 425°C shall be approved in writing by COMPANY unless otherwise specified in supplementary specifications.
- 8.3 Studs shall be threaded full length.
- 8.4 Threads on stud bolts and nuts under 1" diameter shall be coarse thread series. Larger diameter studs shall have Unified 8 Class 2A threads. Nuts shall have Class 2B threads.
- 8.5 The stud length shall be selected so when nuts are fully engaged the stud projects beyond the nuts but not more than two full threads.
- 8.6 Bolt tensioning shall be considered for all bolts 1½" (38 mm) diameter and larger. In addition, for elevated temperatures, cyclic service and other critical joints, controlled tensioning shall be considered.

#### 9. GASKETS

- 9.1 Gaskets shall be provided in accordance with this specification for the applicable Piping Class Rating and Service.
- 9.2 Gaskets shall be according to ASME B16.20 used for ASME B16.5/B16.47 flanges connection. The end types of flanges are RF and RJ.



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 17 of 61

#### **10. NON METALLIC MATERIAL**

For non-metallic material used in this project, related standards shall be followed.

#### 11. SOUR SERVICE PIPING

#### 11.1. General Requirement

All components shall comply with the requirements of NACE MR0175.

Where a difference in Codes, Standards exists, the more stringent requirement shall govern.

If no special definition, the maximum carbon equivalent (CE) of all components shall be less than 0.43%.

If no special definition, the maximum hardness of all components at any position shall be not higher than 220HV(10).

Stainless steels components shall be delivered in the solution heat treated and pickled-inactivation condition.

HIC and SSC test must be done for all sour service valves and piping materials.

#### **11.2. Piping**

Threaded and socket welded piping shall not be used in sour service; such piping shall be butt-welded and flanged.

#### 11.3. Fitting & Flanges

The steel fittings and flanges used in sour service shall comply with the requirements of Specification for A234 WPB Fitting Material in Sour Service and Specification for A105N Flange Material in Sour Service.

#### 11.4. Bolting

ASTM A193 Grade B7M bolting materials and ASTM A194 Grade 2HM nuts material shall be mating with carbon steel components.

Proper bolt tightening procedures shall be used to avoid cold working, or yielding of bolt materials. Impact tightening is not permitted.



Job No.	243007D0796	
Doc. No.	MP00S11	
Phase	DETAILED DESIGN	
Rev.	0	Page 18 of 61

#### 12. PIPING CLASSIFICATIONS AND MATERIAL SPECIFICATIONS

#### 12.1. PIPING CLASS

1	2	3
1	Α	1

#### 1—— Piping Pressure Rating

1	150 pounds rating (ASME codes)
3	300 pounds rating (ASME codes)
6	600 pounds rating (ASME codes)
9	900 pounds rating (ASME codes)
15	1500 pounds rating (ASME codes)
25	2500 pounds rating (ASME codes)
50	5000 pounds rating (API codes)
100	10000 pounds rating (API codes)

#### 2—— Piping Material Classification

А	Carbon Steel
В	Alloy Steel
С	Stainless Steel
D	Carbon Steel Sour Service
Е	Low Temperature Carbon Steel Sour Service
F	Stainless Steel Sour Service
G	Carbon Steel Galvanized Pipe
Н	Cunifer
J	PVDF
К	Carbon Steel with inner coating



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 19 of 61	

L	Super Duplex Stainless Steel (25% Cr)
М	6% Molybdenum
N	Duplex Stainless Steel (22% Cr)
Р	Glass Fibre Reinforced Plastic
R	Duplex Stainless Steel (22% Cr) Sour Service
S	PVCU
Т	High Temperature Carbon Steel(Heating medium service)
U	Steam Jacked Carbon Steel(Liquid Sulfur service)
V	PE
W	Solid-Solution Nickel-Based Alloys
Х	PPR

#### 3——Piping Material Corrosion Grade

0	Corrosion allowance is 0 mm
1	Corrosion allowance is 1mm
2	Corrosion allowance is 2 mm
3	Corrosion allowance is 3 mm
4	Corrosion allowance is 4 mm
6	Corrosion allowance is 6 mm

### 12.2. Abbreviations Used (in alphabetical order)

ABBREVIATION	NAME	NOTE
AL	Aluminum	
ANSI	American National Standard Institute	
API	American Petroleum Institute	
ASME	American Society of Mechanical Engineers	
ASTM	American Society of Testing and Materials	



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 20 of 61	

ABBREVIATION	NAME	NOTE
ATM	Atmosphere	
ВВ	Bolted Bonnet	
BBE	Beveled both Ends	
ВС	Bolted Cover	
BE	Beveled End	
BLE	Beveled Large End	
BOE	Beveled One End	
Br	Bronze	
BRZG	Capillary Brazing End	
BSE	Beveled Small End	
BW	Butt Welding	
CA	Corrosion Allowance	
CAS	Cast Alloy Steel	
ccs	Cast Carbon Steel	
CI	Cast Iron	
CONC	Concentric	
Cr	Chromium	
cs	Carbon Steel	
CSA	Canadian Standards Association	
CuNi	Copper-Nickel	
CWP	Cold Working Pressure	
D	Diameter	
ECC	Eccentric	
EFW	Electric Fusion Welded	
EQ	Equal	
ERW	Electric Resistance Welded	
F6	Stainless Steel, 13% Cr	



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0 Page 21 of 6		

ABBREVIATION	NAME	NOTE
FAS	Forged Alloy Steel	
FCS	Forged Carbon Steel	
FF	Flat Face	
FM	Female Face	
GALV	Galvanize	
Gr	Grade	
HEX	Hexagonal	
НТ	Heat Tracing	
IH	Hot Insulation	
LJ	Lap Joint	
LR	Long Radius	
M	Male Face	
Manuf	Manufacturer	
Max	Maximum	
MI	Malleable Cast iron	
MNPT	Male Threading as per ASME B1.20.1	
Мо	Molybdenum	
MPCS	Micro-porous Calcium Silicate	
MSS	Manufacturer Standardization Society	
NCS	Normalized Carbon Steel	
Ni	Nickel	
NPT	Threading as per ASME B1.20.1	
OD	Outside Diameter	
PBE	Plain both Ends	
PE	Plain End	
PLE	Plain Large End	
РО	Polyurethane	



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 22 of 61	

ABBREVIATION	NAME	NOTE
POE	Plain One End	
PP	Personnel Protection Insulation	
PSE	Plain Small End	
PT	Polyethylene Type	
PVC	Polyvinyl Chloride	
R	Radius	
RED	Reducing	
RF	Raised Face	
RJ	Ring Joint Face	
SAW	Submerged Arc Welding	
SB	Screwed Bonnet	
Sch	Schedule	
SMLS	Seamless	
SS	Stainless Steel	
STD	Standard	
SW	Socket Welding	
TBE	Threaded both Ends	
TE	Threaded End	
THK	Thickness	
TLE	Threaded Large End	
TLPR	Two layer Polyolefin Resin	
TOE	Threaded one End	
TSE	Threaded Small End	
WB	Welded Bonnet	
WN	Welded Neck	

Appendix A and B provide details for the selection and limitations of piping materials for each piping class rating and service. For branching table refer to Appendix C.



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAIL	ED DESIGN	
Rev.	0 Page 23 of 61		
		=	

#### **APPENDIX A**

**PIPING CLASSES SPECIFICATIONS** 



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAIL	ED DESIGN	
Rev.	0 Page 24 of 61		

APPENDIX A PIPING CLASSES SPECIFICATIONS						
Class	Service	Rating	Material	C.A. (mm)	Design Pressure	Design Temperature Limits
	Nitrogen Gas		50# ASTM A106 Gr.B	1	1.2MPa	100°C
1A1	Plant Air	150#			1.2MPa	85°C
	Drain	100#	AGTWATOO GI.B		1.0MPa	85°C
	Air Vent				1.0MPa	85°C
1A3	Fresh Water	150#	ASTM A106 Gr.B	3	0.6MPa	60°C
1A4	Waste Water	150#	ASTM A106 Gr.B	4	ATM-1.0MPa	99°C
1D3	Sour Gas	150#	ASTM A106 Gr.B (SSC&HIC)	3	0.6MPa	99°C
1G0	Instrument Air	150#	ASTM A106 Gr.B +GALV	0	1.2MPa	85°C
1N0	Water Injection	150#	150# ASTM A790 S31803/ A928 S31803	0	1.0MPa	99°C
1110	Waste Water	150#			1.0MPa	99°C
1P0	Water Injection	150#	GRE Epoxy Resins	0	1.0MPa	99°C
	Waste Water	150#	API SPEC 15LR		ATM	99°C
	Nitrogen Gas		# ASTM A106 Gr.B	1	2.2MPa	100°C
3A1	Drain 3007	300#			2.2MPa	100°C
	Air Vent	1			2.2MPa	100°C
3C0	Chemical	300#	ASTM A312-TP316L	0	1.5MPa	85°C
15N0	Water Injection	1500#	ASTM A790 S31803/ A928 S31803	0	25MPa	99°C

#### Notes:

1. Piping Classes listed in Appendix A is for related system based on the design conditions supplied by process.



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 25 of 61		

#### **APPENDIX B**

**PIPING MATERIAL SPECIFICATION** 



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 26 of 61		

1A1	Piping	Piping Material Specification					
Service	See Appendix A				Corrosion Allowance	1 mm	
Rating	150 #				Piping Material	C.S.	
PWHT	NONE						
Pressure-	Tempera	ature Rat	ing		ASME B16.5		
Design Parameter	1.2Mp	a @ 100˚	°C , 1.2Mpa	@ 85°C , 1.	0Мра @ 85°С		
	Inch S	ize	Rating		T N 0 D		
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material	
	1/2"	4.4/0"	800#	sw	BA-1A11 (Floating Ball, Full Bore)		
	1/2	1 1/2"	150#	Flanged, RF	BA-1A12 (Floating Ball, Full Bore)		
	2"	4"	150#	Flanged, RF	BA-1A13 (Floating Ball, Full Bore)		
Ball Valve	6"	18"	150# 150#	Flanged, RF	BA-1A14 (Trunnion Mounted, Full Bore& /W Gear Operator	(Note 1)	
	2"	4"		Flanged,	BA-1A15 (Floating Ball, Reduced Bore)		
	6"	18"	150#	Flanged, RF	BA-1A16 (Trunnion Mounted, Reduced Bore& /W Gear Operator		
			800#	SW	GA-1A11 (Wedge Gate)		
	1/2"	1 1/2"	150#	Flanged, RF	GA-1A12 (Wedge Gate)		
Cata	2"	8"	150#	Flanged, RF	GA-1A13 (Wedge Gate)		
Gate Valve	2"	8"	150#	Flanged, RF	GA-1A14 (Flat Gate)	(Note 1)	
10" 18"	18"	150#	Flanged, RF	GA-1A15 (Wedge Gate & /W Gear Operator)			
	10"	18"	150#	Flanged, RF	GA-1A16 ((Flat Gate & /W Gear Operator)		
Globe Valve	1/2"	1 1/2"	150#	Flanged, RF	GL-1A11 (Swivel Type Plug)	(Note 1)	



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 27 of 61		

1A1	Piping Material Specification					
Service	See A	ppendix /	4		Corrosion Allowance	1 mm
Rating	150 #				Piping Material	C.S.
PWHT	NONE					
Pressure-	Tempera	ature Rat	ing		ASME B16.5	
Design Parameter	1.2Mpa	a @ 100'	°C , 1.2Mpa	@ 85°C , 1.	0Мра @ 85°С	
Items	Inch S	ize	Rating	End	Tog No. 9 Description	Main Material
items	From	То	Sch./Thk.	Ena	Tag No. & Description	Mairi Materiai
	2"	6"	450#	Flanged,	GL-1A12 (Swivel Type	
	2"	6.	150#	RF	Plug & Renewable Seat)	
				Flanged,	GL-1A13 (Swivel Type	
	8"	16"	150#	RF	Plug & Renewable Seat	
					With Gear Operator)	
Check	1/2"	1 1/2"	150#	Flanged, RF	CK-1A11 (Lift)	(NI-4- 4)
Valve	2"	18"	150#	Flanged,	CK-1A12 (Wafer)	(Note 1)
				Flanged,	BT-1A11 (Three-	
	6" 6"	6"	150#	RF	Eccentricity)	
Butterfly Valve	8"	18"	150#	Flanged, RF	BT-1A12 (Three- Eccentricity With Gear Operator)	(Note 1)
	1/2"	1 1/2"	SCH80	PE	Seamless, Steel Pipe	
Pipe	2"	6"	SCH40	BE	Seamless, Steel Pipe	ASTM A106 Gr.B To
	8"	18"	SCH30	BE	Seamless, Steel Pipe	ASME B36.10 (Note 2)
	1/2"	1 1/2"	SCH160	PE xMNPT	Seamless, Steel Pipe (80mm Long)	ASTM A106 Gr.B To
Nipple	1/2"	1 1/2"	SCH160	MNPT xMNPT	Seamless, Steel Pipe (80mm Long)	ASME B36.10
	1/2"	1 1/2"	3000#	SW	Elbow, Tee, Cap, Swage Nipple	ASTM A234 Gr.WPB To ASME B16.11 & MSS SP-95 (Note 3)
Fittings	1/2"	1 1/2"	3000#	NPT	Сар	ASTM A234 Gr.WPB To ASME B16.11 (Note 4)
	1/2"	1 1/2"	3000#	sw	Sockolets	ASTM A105 To MSS SP-97 (Note 3)
	2"	6"	SCH40	BW	Elbow (LR), Tee,	ASTM A234 Gr.WPB To



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 28 of 61		

1A1	Piping Material Specification						
Service	See Ap	pendix /	4		Corrosion Allowance	1 mm	
Rating	150 #				Piping Material	C.S.	
PWHT	NONE						
Pressure-	Tempera	iture Rat	ing		ASME B16.5		
Design Parameter	1.2Mpa	a @ 100°	°C , 1.2Mpa	@ 85°C , 1.	0Мра @ 85°С		
ltanaa	Inch Si	ze	Rating	F al	Tow No. 9 December	Main Matarial	
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material	
	8"	40"	001100	DVA	Reducing Tee,	ASME B16.9 (Note 5)	
	0	18"	SCH30	BW	Reducer, Cap		
	2"	6"	SCH40	BW	Malalaka	ASTM A105 To MSS	
	8"	8"	SCH30	BW	Weldolets	SP-97 (Note 5)	
	4/0"	4.4/0"	450#	CW/DE	Socket Welding	ASTM A105 To ASME	
	1/2"	1 1/2"	150#	SW/RF	(Note 5)	B16.5	
	2"	18"	150#	Flanged,	Welding Neck	ASTM A105 To ASME	
		18	150#	RF	(Note 5)	B16.5	
Florace	1/2" 18" 150#	/2" 18" 150# Flanged,	Blind	ASTM A105 To ASME			
Flanges	1/2	10	150#	RF	DIITU	B16.5	
	1/2"	12"	150#	RF	Spectacle Blank	ASTM A105 To ASME	
	14"	18"	150#	RF	Blinds and Spacer	B16.48	
	0"	18"	200#	Flanged,		ASTM A105 To ASME	
	2"	18	300#	RF	Orifice Flange Set	B16.36	
					Full Length, /W Two HVY	Stud Bolts Alloy Steel	
Studs/	4/0"	40"	450#	NI/A	Hexagonal Nuts To	ASTM A193-B7/194-2H	
Nuts	Nuts 1/2" 18"	150#	N/A	ASME B16.5/B18.31.2	Hot Dip Galvanized To		
					/B18.2.2	ASTM A153	
					Chirolly Mound My Inc.	SS 316L/FG 4.5mm	
Gasket	1/2"	18"	150#	RF	Spirally Wound /W Inner	Thk OR/IR:316L To	
					& Outer Rings	ASME B16.20	

#### Notes:

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Bevelled end as per ASME B16.25.
- 3. Socket weld shall be as per ASME B16.11.
- 4. Threaded end as per ASME B1.20.1.
- 5. Thickness to suit pipe.



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 29 of 61		

1A3	Piping	Piping Material Specification					
Service	See A	ppendix	A		Corrosion Allowance	3 mm	
Rating	150 #				Piping Material	C.S.	
PWHT	NONE						
Design Parameter	0.6Mp	a @ 60°0	С				
14	Inch S	ize	Rating	F	Tou No. 9 December 41 and	Main Matarial	
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material	
	1/2"	1 1/2"	150#	Flanged, RF	BA-1A31 (Floating Ball, Full Bore)		
	2"	4"	150#	Flanged, RF	BA-1A32 (Floating Ball, Full Bore)		
Ball Valve	6"	18"	150#	Flanged, RF	BA-1A33 (Trunnion Mounted, Full Bore& /W Gear Operator	(Note 1)	
	2"	4"	150#	, , ,	BA-1A34 (Floating Ball, Reduced Bore)		
	6"	18"	150#	Flanged,	BA-1A35 (Trunnion Mounted, Reduced Bore& /W Gear Operator		
	1/2"	1 1/2"	150#	Flanged, RF	GA-1A31 (Wedge Gate)		
	2"	8"	150#	Flanged,	GA-1A32 (Wedge Gate)		
Gate Valve	2"	8"	150#	Flanged,	GA-1A33 (Flat Gate)	(Note 1)	
	10"	18"	150#	Flanged, RF	GA-1A34 (Wedge Gate & /W Gear Operator)		
	10"	18"	150#	Flanged, RF	GA-1A35 ((Flat Gate & /W Gear Operator)		
	1/2"	1 1/2"	150#	Flanged, RF	GL-1A31 (Swivel Type Plug)		
Globe	2"	6"	150#	Flanged, RF	GL-1A32 (Swivel Type Plug & Renewable Seat)	(Note 1)	
Valve	8"	16"	150#	Flanged, RF	GL-1A33 (Swivel Type Plug & Renewable Seat With Gear Operator)		
Check Valve	1/2"	1 1/2"	150#	Flanged, RF	CK-1A31 (Lift)	(Note 1)	



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 30 of 61		

1A3	Piping Material Specification					
Service	See A	opendix .	A		Corrosion Allowance	3 mm
Rating	150 #				Piping Material	C.S.
PWHT	NONE					
Design Parameter	0.6Mpa	a @ 60°0	С			
	Inch S	ize	Rating			
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material
	2"	18"	150#	Flanged, RF	CK-1A32 (Wafer)	
	1/2"	1 1/2"	SCH160	BE	Seamless, Steel Pipe	
Dina	2"	2"	SCH80	BE	Seamless, Steel Pipe	ASTM A106 Gr.B To
Pipe	3"	6"	SCH40	BE	Seamless, Steel Pipe	ASME B36.10 (Note 2)
	8"	18"	SCH30	BE	Seamless, Steel Pipe	
	1/2"	1 1/2"	XXS	BE	Seamless, Steel Pipe	ACTM A400 C: D T-
Nipple	Nipple		xMNPT	(80mm Long)	ASTM A106 Gr.B To	
	1/2"   1 1/2"   XXS		MNPT xMNPT	Seamless, Steel Pipe (80mm Long)	ASME B36.10	
	1/2"	1 1/2"	SCH160	BW		ASTM A234 Gr.WPB To ASME B16.9 (Note 3)
	2"	2"	SCH80	BW	Elbow (LR), Tee,	
	3"	6"	SCH40	BW	Reducing Tee,	
	8"	18"	SCH30	BW	Reducer, Cap	
Fittings	1/2"	1 1/2"	SCH160	BW		
	2"	2"	SCH80	BW	<b></b>	ASTM A105 To MSS
	3"	6"	SCH40	BW	Weldolets	SP-97 (Note 3)
	8"	18"	SCH30	BW		
	1/2"	18"	150#	Flanged, RF	Welding Neck (Note 3)	ASTM A105 To ASME B16.5
	1/2"	18"	150#	Flanged,	Blind	ASTM A105 To ASME B16.5
Flanges	1/2"	12"	150#	RF	Spectacle Blank	ASTM A105 To ASME
	14"	18"	150#	RF	Blinds and Spacer	B16.48
	2"	18"	300#	Flanged, RF	Orifice Flange Set	ASTM A105 To ASME B16.36
Studs/ Nuts	1/2"	18"	150#	N/A	Full Length, /W Two HVY Hexagonal Nuts To ASME B16.5/B18.31.2 /B18.2.2	Stud Bolts Alloy Steel ASTM A193-B7/194-2H Hot Dip Galvanized To ASTM A153



Job No.	243007D0796				
Doc. No.	MP00S11				
Phase	DETAILED DESIGN				
Rev.	0	Page 31 of 61			

1A3	Piping	Piping Material Specification					
Service	See A	pendix	A		Corrosion Allowance	3 mm	
Rating	150 #				Piping Material	C.S.	
PWHT	NONE						
Design Parameter	0.6Mpa	0.6Mpa @ 60°C					
Items	Inch Size Rating End Sch./Thk.			End	Tag No. & Description	Main Material	
Gasket	1/2" 18" 150# RF		Spirally Wound /W Inner & Outer Rings	SS 316L/FG 4.5mm Thk OR/IR:316L To ASME B16.20			

#### Notes:

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Bevelled end as per ASME B16.25.
- 3. Thickness to suit pipe.



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAIL	ED DESIGN	
Rev.	0	Page 32 of 61	

1A4	Piping	Piping Material Specification							
Service	See A	ppendix	A		Corrosion Allowance	4 mm			
Rating	150 #				Piping Material	C.S.			
PWHT	NONE								
Design Parameter	ATM -	1.0Mpa	@ 99°C						
14	Inch S	ize	Rating	F	Tou No. 9 December 41 and	Main Matarial			
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material			
	1/2"	1 1/2"	150#	Flanged, RF	BA-1A41 (Floating Ball, Full Bore)				
	2"	4"	150#	Flanged, RF	BA-1A42 (Floating Ball, Full Bore)				
Ball Valve	6"	18"	150#	Flanged, RF	BA-1A43 (Trunnion Mounted, Full Bore& /W Gear Operator	(Note 1)			
	2"	4"	150#	Flanged, RF	BA-1A44 (Floating Ball, Reduced Bore)				
	6"	18"	150#	Flanged,	BA-1A45 (Trunnion Mounted, Reduced Bore& /W Gear Operator				
	1/2"	1 1/2"	150#	Flanged, RF	GA-1A41 (Wedge Gate)				
	2"	8"	150#	Flanged,	GA-1A42 (Wedge Gate)				
Gate Valve	2"	8"	150#	Flanged,	GA-1A43 (Flat Gate)	(Note 1)			
	10"	18"	150#	Flanged, RF	GA-1A44 (Wedge Gate & /W Gear Operator)				
	10"	18"	150#	Flanged, RF	GA-1A45 ((Flat Gate & /W Gear Operator)				
	1/2"	1 1/2"	150#	Flanged, RF	GL-1A41 (Swivel Type Plug)				
Globe	2"	6"	150#	Flanged, RF	GL-1A42 (Swivel Type Plug & Renewable Seat)	(Note 1)			
Valve	8"	16"	150#	Flanged, RF	GL-1A43 (Swivel Type Plug & Renewable Seat With Gear Operator)				
Check Valve	1/2"	1 1/2"	150#	Flanged, RF	CK-1A41 (Lift)	(Note 1)			



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0 Page 33 of 61		

1A4	Piping	Piping Material Specification							
Service	See A	ppendix	A		Corrosion Allowance	4 mm			
Rating	150 #				Piping Material	C.S.			
PWHT	NONE	<u> </u>							
Design Parameter	ATM -	1.0Mpa	@ 99°C						
	Inch S	ize	Rating						
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material			
	2"	18"	150#	Flanged, RF	CK-1A42 (Wafer)				
	1/2"	3/4"	XXS	BE	Seamless, Steel Pipe				
	1"	1 1/2"	SCH160	BE	Seamless, Steel Pipe				
	2"	2"	SCH160	BE	Seamless, Steel Pipe	ASTM A106 Gr.B To			
Pipe	3"	4"	SCH80	BE	Seamless, Steel Pipe	ASME B36.10 (Note 2)			
	6"	8"	SCH40	BE	Seamless, Steel Pipe				
	10"	18"	SCH30	BE	Seamless, Steel Pipe				
				BE	Seamless, Steel Pipe				
<b>.</b>	1/2"	1 1/2"	XXS	xMNPT	(80mm Long)	ASTM A106 Gr.B To			
Nipple	1/2"	1 1/2"	xxs	MNPT xMNPT	Seamless, Steel Pipe (80mm Long)	ASME B36.10			
	1/2"	3/4"	xxs	BW	(BOITIIII LONG)				
	1"	1 1/2"	SCH160	BW	Reducing Tee.	ASTM A234 Gr.WPB To ASME B16.9 (Note 3)			
	2"	2"	SCH160	BW					
	3"	4"	SCH80	BW					
	6"	8"	SCH40	BW					
	10"	18"	SCH30	BW					
Fittings	1/2"	3/4"	XXS	BW					
	1"	1 1/2"	SCH160	BW	-				
	2"	2"	SCH160	BW	-	ASTM A105 To MSS			
	3"	4"	SCH80	BW	Weldolets	SP-97 (Note 3)			
	6"	8"	SCH40	BW	-	31 -37 (Note 3)			
	10"	18"	SCH30	BW	_				
	1/2"	18"	150#	Flanged,	Welding Neck (Note 3)	ASTM A105 To ASME			
		-		RF	(1111)	B16.5			
	1/2"	18"	150#	Flanged, RF	Blind	ASTM A105 To ASME B16.5			
Flanges	1/2"	12"	150#	RF	Spectacle Blank	ASTM A105 To ASME			
	14"	18"	150#	RF	Blinds and Spacer	B16.48			
	2"	18"	300#	Flanged, RF	Orifice Flange Set	ASTM A105 To ASME B16.36			



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAIL	ED DESIGN	
Rev.	0 Page 34 of 61		

1A4	Piping Material Specification						
Service	See Appendix A				Corrosion Allowance	4 mm	
Rating	150#				Piping Material	C.S.	
PWHT	NONE						
Design Parameter	ATM - 1.0Mpa @ 99°C						
Items	Inch S	ize	Rating	End	Tag No. & Description	Main Material	
Itomo	From	То	Sch./Thk.	Liid		Wall Waterlai	
Studs/ Nuts	1/2"	18"	150#	N/A	Full Length, /W Two HVY Hexagonal Nuts To ASME B16.5/B18.31.2 /B18.2.2	Stud Bolts Alloy Steel ASTM A193-B7/194-2H Hot Dip Galvanized To ASTM A153	
Gasket	1/2"	18"	150# RF		Spirally Wound /W Inner & Outer Rings	S31803/FG 4.5mm Thk OR/IR:S31803 To ASME B16.20	

#### Notes:

- $1.\ For\ details,\ see\ CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION\ FOR\ MANUAL\ VALVES.$
- 2. Bevelled end as per ASME B16.25.
- 3. Thickness to suit pipe.



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAIL	ED DESIGN	
Rev.	0 Page 35 of 61		

1D3	Piping Material Specification							
Service	See A	opendix /	4		Corrosion Allowance	3 mm		
Rating	150 #				Piping Material	C.S. (NACE)		
PWHT	YES							
Pressure-	Tempera	ature Rat	ing		ASME B16.5			
Design Parameter	0.6Mpa	a @ 99°0	0					
.,	Inch S	ize	Rating		T N 05 ''			
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material		
	1/2"	1 1/2"	150#	Flanged, RF	BA-1D31S (Floating Ball, Full Bore)			
	2"	4"	150#	Flanged,	BA-1D32S (Floating Ball, Full Bore)			
Ball Valve	6"	18"	150#	Flanged, RF	BA-1D33S (Trunnion Mounted, Full Bore& /W Gear Operator	(Note 1)		
	2"	4"	150#	Flanged, RF	BA-1D34S (Floating Ball, Reduced Bore)			
	6"	18"	150#	Flanged,	BA-1D35S (Trunnion Mounted, Reduced Bore& /W Gear Operator			
	1/2"	1 1/2"	150#	Flanged,	GA-1D31S (Wedge Gate)			
	2"	8"	150#	Flanged,	GA-1D32S (Wedge Gate)			
Gate Valve	2"	8"	150#	Flanged,	GA-1D33S (Flat Gate)	(Note 1)		
	10"	18"	150#	Flanged,	GA-1D34S (Wedge Gate & /W Gear Operator)			
	10"	18"	150#	Flanged,	GA-1D35S (Flat Gate & /W Gear Operator)			
	1/2"	1 1/2"	150#	Flanged,	GL-1D31S (Swivel Type Plug)			
Globe	2"	6"	150#	Flanged,	GL-1D32S (Swivel Type Plug & Renewable Seat)	(Note 1)		
Valve	8"	16"	150#	Flanged,	GL-1D33S (Swivel Type Plug & Renewable Seat With Gear Operator)			



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAIL	ED DESIGN	
Rev.	0	Page 36 of 61	

1D3	Piping	Piping Material Specification							
Service	See Ap	pendix /	Α		Corrosion Allowance	3 mm			
Rating	150 #				Piping Material	C.S. (NACE)			
PWHT	YES								
Pressure-	Tempera	iture Rat	ing		ASME B16.5				
Design Parameter	0.6Mpa	a @ 99°0		1					
Items	Inch Si	ze	Rating	End	Tag No. & Description	Main Material			
Items	From	То	Sch./Thk.	Liiu	rag No. & Description	Iviaiii iviateriai			
Check	1/2"	1 1/2"	150#	Flanged, RF	CK-1D31S (Lift)	(Note 1)			
Valve	2"	18"	150#	Flanged, RF	CK-1D32S (Wafer)	(Note 1)			
	1/2"	1 1/2"	SCH160	BE	Seamless, Steel Pipe	A C T M A 4 0 C C C C			
Din -	2"	2"	SCH80	BE	Seamless, Steel Pipe	ASTM A106 Gr.B			
Pipe	3"	6"	SCH40	BE	Seamless, Steel Pipe	(SSC&HIC) To ASME			
	8"	18"	SCH30	BE	Seamless, Steel Pipe	B36.10 (Note 2)			
	1/2"	1 1/2"	xxs	BE xMNPT	Seamless, Steel Pipe (80mm Long)	ASTM A106 Gr.B			
Nipple	1/2"	1 1/2"	xxs	MNPT xMNPT	Seamless, Steel Pipe (80mm Long)	(SSC&HIC) To ASME B36.10			
	1/2"	1 1/2"	SCH160	BW	Elbow (LR), Tee, ASTM ASTM (SSC&I	ASTM A234 Gr.WPB (SSC&HIC) To ASME			
	2"	2"	SCH80	BW					
	3"	6"	SCH40	BW					
	8"	18"	SCH30	BW		B16.9 (Note 3)			
	6"	6"	SCH40	BW		ASTM A234 Gr.WPB			
Fittings	8"	18"	SCH30	BW	Elbow (5D)	(SSC&HIC) To ASME B16.9 (Note 3&4)			
	1/2"	1 1/2"	SCH160	BW					
	2"	2"	SCH80	BW	],,,,,,,	ASTM A105N			
	3"	6"	SCH40	BW	Weldolets	(SSC&HIC) To MSS			
	8"	8"	SCH30	BW		SP-97 (Note 3)			
	1/2"	18"	150#	Flanged, RF	Welding Neck (Note 3)	ASTM A105N (SSC&HIC) To ASME B16.5			
Flanges	1/2"	18"	150#	Flanged, RF	Blind	ASTM A105N (SSC&HIC) To ASME B16.5			
	1/2"	12"	150#	RF	Spectacle Blank	ASTM A105N			



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 37 of 61	

1D3	Piping	Piping Material Specification							
Service	See Appendix A				Corrosion Allowance	3 mm			
Rating	150 #				Piping Material	C.S. (NACE)			
PWHT	YES								
Pressure-	Гетрега	ture Rat	ing		ASME B16.5				
Design Parameter	0.6Mpa	a @ 99°0	C						
Itomo	Inch Si	ze	Rating	End	Tag No. 9 Deceription	Main Material			
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material			
	14"	18"	150#	RF	Blinds and Spacer	(SSC&HIC) To ASME			
	14	10	130#	INF		B16.48			
				Flanged,	Orifice Flange Set	ASTM A105N			
	2"	18"	300#	RF		(SSC&HIC) To ASME			
				IXI		B16.36			
					Full Length, /W Two HVY	Stud Bolts Alloy Steel			
Studs/					Hexagonal Nuts To	ASTM A193-B7M/			
Nuts	1/2"	18"	150#	N/A	ASME B16.5/B18.31.2	194-2HM Hot Dip			
Italo					/B18.2.2	Galvanized To ASTM			
					7010.2.2	A153			
					Spirally Wound /W Inner	SS 316L/FG 4.5mm			
Gasket	1/2"	18"	150#	RF	RF   ' '	Thk OR/IR:316L To			
					& Outer Rings	ASME B16.20			

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Bevelled end as per ASME B16.25.
- 3. Thickness to suit pipe.
- 4. Each end with 1D straight pipe (Not less than 250mm).



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 38 of 61		

1G0	Piping	Piping Material Specification						
Service	See Appendix A				Corrosion Allowance	0 mm		
Rating	150 #				Piping Material	C.S.(Galv)		
PWHT	NONE							
Pressure-	Temper	ature Rat	ing		ASME B16.5			
Design Parameter	1.2 Mp	oa @ 85°	С					
11	Inch S	ize	Rating		Tanka O Danishtian	NA da NA A da		
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material		
	1/2"	1 1/2"	150#	Flanged, RF	BA-1G01 (Floating Ball, Full Bore)			
Ball Valve	2"	4"	150#	Flanged, RF	BA-1G02(Floating Ball, Full Bore)	(Note 1)		
	2"	4"	150#	Flanged,	BA-1G03(Floating Ball, Reduced Bore)			
Gate	1/2"	1 1/2"	150#	Flanged,	GA-1G01 (Wedge Gate)	(Note 1)		
Valve	2"	4"	150#	Flanged,	GA-1G02 (Wedge Gate)			
Globe	1/2"	1 1/2"	150#	Flanged,	GL-1G01 (Swivel Type Plug)	(Note 1)		
Valve	2"	4"	150#	Flanged, RF	GL-1G02 (Swivel Type Plug & Renewable Seat)			
Check	1/2"	1 1/2"	150#	Flanged, RF	CK-1G01 (Lift)			
Valve	2"	4"	150#	Flanged, RF	CK-1G02 (Wafer)	(Note 1)		
	1/2"	2"	SCH80	NPTM	Seamless, Hot Dip Galvanized	ASTM A106 GR.B		
Pipe	3"	4"	SCH40	NPTM	Seamless, Hot Dip Galvanized	Galvanized To ASME B36.10 (Note 2, 3, 4&5)		
Fittings	1/2"	2"	CL3000	NPTF	Cap, Coupling Elbow (LR) ,Tee, Union	ASTM A105+ Galvanized To ASME B16.11 & MSS SP-83 (Note 2&5)		
	1/2"	2"	CL3000	NPTM	Swage Nipple	ASTM A105+ Galvanized To MSS SP-95 (Note 2, 4&5)		



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 39 of 61		

1G0	Piping	Material	Specification	n		
Service	See Appendix A				Corrosion Allowance	0 mm
Rating	150 #				Piping Material	C.S.(Galv)
PWHT	NONE					
Pressure-	Tempera	ature Rat	ing		ASME B16.5	
Design Parameter	1.2 Mp	oa @ 85°	С			
	Inch S	ize	Rating		T 11 0 5 1 11	
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material
					Cap, Coupling	ASTM A105 +
	3"	4"	CL3000	L3000 NPTF	Elbow (LR) ,Tee,	Galvanized To ASME
					Reducing Tee	B16.11 (Note 2&5)
	1/2"	4"	150#	NPTF/R	Thread (Note 6)	ASTM A105+
						Galvanized To ASME
				Г		B16.5
			150#	RF	Blind	ASTM A105+
Flanges	1/2"	4"				Galvanized To ASME
						B16.5
						ASTM A105+
	1/2"	4"	150#	RF	Spectacle Blank	Galvanized To ASME
						B16.48
					Full Length, /W Two HVY	Stud Bolts Alloy Steel
Studs/	1/2"	4"	150#	N/A	Hexagonal Nuts To	ASTM A193-B7/194-2H
Nuts		4	150#	11/7	ASME B16.5/B18.31.2	Hot Dip Galvanized To
					/B18.2.2	ASTM A153
Gasket	1/2"	4"	150#	RF	Non-Metal Gasket,	RPTFE 3.2mm Thk To
Jasket	1/2	<b>-</b>	150π	IXI	Asbestos Free	ASME B16.21

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Threaded end as per ASME B1.20.1.
- 3. What is above-mentioned to be hot dip Galvanized shall be in accordance to ASTM A153-B.
- 4. The threaded end (NPTM) shall be by ASME B1.20.1.
- 5. Pipe to pipe joining for all sizes shall be by means of screwed full coupling.
- 6. Thickness to suit pipe.



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0 Page 40 of 61			

1N0	Piping	Piping Material Specification						
Service	See A	ppendix A	١		Corrosion Allowance	0 mm		
Rating	150 #				Piping Material	ASTM A790-S31803		
PWHT	NONE							
Pressure-Temperature Rating					ASME B16.5			
Design Parameter	1.0Mpa @ 99°C							
Items	Inch S From	ize To	Rating Sch./Thk.	End	Tag No. & Description	Main Material		
	1/2"	1 1/2"	150#	Flanged,	BA-1N01 (Floating Ball, Full Bore)			
	2"	4"	150#	Flanged, RF	BA-1N02 (Floating Ball, Full Bore)			
Ball Valve	6"	24"	150#	Flanged,	BA-1N03 (Trunnion Mounted, Full Bore/W Gear Operator	(Note 1)		
	2"	4"	150#	Flanged, RF	BA-1N04 (Floating Ball, Reduced Bore)			
	6"	24"	150#	Flanged,	BA-1N05 (Trunnion Mounted, Reduced Bore& /W Gear Operator			
	1/2"	1 1/2"	150#	Flanged, RF	GA-1N01 (Wedge Gate)			
	2"	8"	150#	Flanged, RF	GA-1N02 (Wedge Gate)			
Gate Valve	2"	8"	150#	Flanged, RF	GA-1N03 (Flat Gate)	(Note 1)		
	10"	24"	150#	Flanged, RF	GA-1N04 (Wedge Gate & Gear Operator)			
	10"	24"	150#	Flanged, RF	GA-1N05 ((Flat Gate & /W Gear Operator)			
	1/2"	1 1/2"	150#	Flanged, RF	GL-1N01 (Swivel Type Plug)			
Globe	2"	6"	150#	Flanged, RF	GL-1N02 (Swivel Type Plug & Renewable Seat)	(Note 1)		
Valve	8"	16"	150#	Flanged, RF	GL-1N03 (Swivel Type Plug & Renewable Seat With Gear Operator)			



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 41 of 61		

1N0	Piping	Piping Material Specification							
Service	See Appendix A				Corrosion Allowance	0 mm			
Rating	150 #				Piping Material	ASTM A790-S31803			
PWHT	NONE								
Pressure-	Tempera	ature Rati	ng		ASME B16.5				
Design Parameter	1.0Mp	a @ 99°C	,						
Items	Inch S From	ize To	Rating Sch./Thk.	End	Tag No. & Description	Main Material			
Check	1/2"	1 1/2"	150#	Flanged,	CK-1N01 (Lift)				
Valve	2"	24"	150#	Flanged,	CK-1N02 (Wafer)	(Note 1)			
Butterfly	6"	6"	150#	Flanged, RF	BT-1N01	(Note 1)			
Valve	8"	24"	150#	Flanged, RF	BT-1N02	(Note 1)			
	1/2"	1 1/2"	SCH40S	BE	Seamless, Duplex Stainless Pipe	ASTM A790-S31803 To			
Pipe	2"	12"	SCH10S	BE	Seamless, Duplex Stainless Pipe	ASME B36.19 (Note 2)			
	14"	24"	SCH10S	BE	EFW, Duplex Stainless Pipe	ASTM A928-S31803 CLASS 1 Welded To ASME B36.19			
	1/2"	1 1/2"	SCH80S	BE xMNPT	Seamless, Duplex Stainless Pipe (80mm Long)	ASTM A790-S31803 To			
Nipple	1/2"	1 1/2"	SCH80S	MNPT xMNPT	Seamless, Duplex Stainless Pipe (80mm Long)	ASME B36.19			
	1/2"	1 1/2"	SCH40S	BW		ASTM A815-S31803			
	2"	12"	SCH10S	BW	Elbow (LR), Tee, Reducer, Cap	WP-S To ASME B16.9 (Note 3)			
Fittings	14"	24"	SCH10S	BW	Welded, Elbow (LR), Tee, Reducer, Cap	ASTM A815-S31803 WP-WX To ASME B16.9 (Note 3)			
	1/2"	1 1/2"	SCH40S	BW	Woldalata	ASTM A182-F51 To			
	2"	8"	SCH10S	BW	Weldolets	MSS SP-97 (Note 3)			
Flanges	1/2"	24"	150#	Flanged, RF	Welding Neck (Note 3)	ASTM A182-F51 To ASME B16.5			



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 42 of 61		

1N0	Piping Material Specification						
Service	See Appendix A			ı	Corrosion Allowance	0 mm	
Rating	150 #	ppendix <i>F</i>	\			ASTM A790-S31803	
PWHT	NONE				Piping Material	ASTIVI A790-331603	
					A ONE DAGE		
Pressure-	l empera	iture Ratii	ng		ASME B16.5		
Design Parameter	1.0Mp	a @ 99°C	,	1			
Items	Inch S	ize	Rating	End	Tag No. & Description	   Main Material	
items	From	То	Sch./Thk.	Ella	rag No. & Description	Iviairi iviateriai	
	1"	24"	150#	Flanged, FF	Flat Face (Note 4)		
	1/2"	24"	150#	Flanged, RF	Blind		
	1/2"	12"	150#	RF	Spectacle Blank	ASTM A182-F51 To	
	14"	24"	150#	RF	Blinds and Spacer	ASME B16.48	
	2"	24"	300#	Flanged,	Orifice Flange Set	ASTM A182-F51 To ASME B16.36	
Studs/ Nuts	1/2"	24"	150#	N/A	Full Length, /W Two HVY Hexagonal Nuts To ASME B16.5/B18.31.2 /B18.2.2	Stud Bolts Alloy Steel ASTM A193-B7M/ A194-2HM XYLAN Fluoropolymer Coated	
Gasket	1/2"	24"	150#	RF	Spirally Wound /W Inner & Outer Rings	S31803/FG 4.5mm Thk OR/IR:S31803 To ASME B16.20	
Insulation Gasket	1/2"	24"	150#	RF	TYPE F FLANGE INSULATION KITS, MAX WATER ABSORPTION 0.1%, MIN INSULATION PROPERTY 10 MOHM ASME B16.5	NEMA GRADE G-10 GLASS REINFORCED EPOXY ELECTRICALLY INSULATED RETAINER W/VITON SEALING, NEMA GRADE G-10 SLEEVES, DOUBLE NEMA GRADE G-10 WASHERS AND DOUBLE ZP STEEL WASHERS PER SLEEVE, 3.2MM THK	

Notes:

1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 43 of 61	

- 2. Bevelled end as per ASME B16.25.
- 3. Thickness to suit pipe.
- 4. Used for connection with GRE piping.



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 44 of 61	

1P0	Piping	Piping Material Specification					
Service	See A	See Appendix A			Corrosion Allowance	0 mm	
Rating	150 #				Piping Material	GRE	
PWHT	NONE				Fire Resistance	L3	
Design Parameter	1.0Mpa	a @ 99°C	,				
Items	Inch S	ize	Rating	End	Tag No. & Description	Main Material	
ILCIIIS	From	То	Sch./Thk.	Eliu	rag No. & Description	Iviali i ivialeriai	
	1/2"	1 1/2"	150#	Flanged, FF	BA-1P01 (Floating Ball, Full Bore)		
	2"	4"	150#	Flanged, FF	BA-1P02 (Floating Ball, Full Bore)		
Ball Valve	6"	18"	150#	Flanged, FF	BA-1P03 (Trunnion Mounted, Full Bore/W Gear Operator	(Note 1)	
vaive	2"	4"	150#	Flanged, FF	BA-1P04 (Floating Ball, Reduced Bore)		
	6"	18"	150#	Flanged, FF	BA-1P05 (Trunnion Mounted, Reduced Bore& /W Gear Operator		
	1/2"	1 1/2"	150#	Flanged, FF	GA-1P01 (Wedge Gate)		
	2"	8"	150#	Flanged, FF	GA-1P02 (Wedge Gate)		
Gate	2"	8"	150#	Flanged, FF	GA-1P03 (Wedge Gate & Gear Operator)	(Note 1)	
Valve	10"	18"	150#	Flanged, FF	GA-1P04 (Flat Gate)		
	10"	18"	150#	Flanged, FF	GA-1P05 ((Flat Gate & /W Gear Operator)		
	1/2"	1 1/2"	150#	Flanged, FF	GL-1P01 (Swivel Type Plug)		
Globe Valve	2"	6"	150#	Flanged, FF	GL-1P02 (Swivel Type Plug & Renewable Seat)	(Note 1)	
	8"	16"	150#	Flanged, FF	GL-1P03 (Swivel Type Plug & Renewable Seat With Gear Operator)		
Check	1/2"	1 1/2"	150#	Flanged, FF	CK-1P01 (Lift)	(Note 1)	
Valve	2"	18"	150#	Flanged, FF	CK-1P02 (Wafer)	(Note 1)	



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 45 of 61	

1P0	Piping	Piping Material Specification				
Service	See A	See Appendix A			Corrosion Allowance	0 mm
Rating	150 #	150 #			Piping Material	GRE
PWHT	NONE				Fire Resistance	L3
Design Parameter	1.0Mp	a @ 99°C	,			
Items	Inch S From	ize To	Rating Sch./Thk.	End	Tag No. & Description	Main Material
Pipe	1"	18"	1.6 Mpa	Taper/ Taper Type, Socket End	Pipe, Filament Wound, UV Inhibition (Above Ground), Safety Factor 4, As Per Design Condition 1.0MPa@99°C	GRE, Epoxy Resins API 15LR
Fitting	1"	18"	1.6 Mpa	Taper/ Taper Type, Socket End	Elbow, Tee, Reducing Tee, Coupling, Cap, Union, Reducer, Saddle, Filament Wound, UV Inhibition (Above Ground), Safety Factor 4, As Per Design Condition 1.0MPa@99°C	GRE, Epoxy Resins API 15LR (Note 2)
Adaptor	2"	18"	1.6Mpa	Taper/ Taper Type, Socket End	Adaptor , Filament Wound, UV Inhibition (Above Ground), Safety Factor 4, As Per Design Condition 1.0MPa@99°C	GRE, Epoxy Resins API 15LR
Fl	1"	18"	150#	Flanged, FF/ Taper/ Taper Type, Socket End	Flange, Filament Wound, UV Inhibition (Above Ground), Safety Factor 4, As Per Design Condition 1.0MPa@99°C (Note 2)	GRE, Epoxy Resins
Flanges	1"	18"	150#	Flanged, FF	Blind, Filament Wound, UV Inhibition (Above Ground), Safety Factor 4, As Per Design Condition 1.0MPa@99°C	API 15LR To ASME B16.5



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 46 of 61	

1P0	Piping	Piping Material Specification				
Service	See Ap	pendix A	١		Corrosion Allowance	0 mm
Rating	150 #				Piping Material	GRE
PWHT	NONE				Fire Resistance	L3
Design Parameter	1.0Mpa @ 99°C					
14	Inch S	ize	Rating	F	To a No. O December 11 and	NA dia NA dia dia l
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material
Studs/ Nuts	1"	18"	150#	N/A	Full Length, /W Two HVY Hexagonal Nuts & 2 Washers, To ASME B16.5/B18.31.2 /B18.2.2	Stud Bolts, Alloy Steel, ASTM A193-B7M /A194-2HM XYLAN Fluoropolymer Coated
Gasket	1"	18"	150#	FF	Non-Metal Gasket, Asbestos Free	RPTFE 3.2mm Thk To ASME B16.21

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Thickness to suit pipe.



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 47 of 61		

3A1	Piping	Piping Material Specification					
Service	See Appendix A				Corrosion Allowance	1 mm	
Rating	300 #				Piping Material	C.S.	
PWHT	NONE						
Pressure-T	empera	ture Rati	ng		ASME B16.5		
Design Parameter	2.2Mp	a @ 100°	°C				
Items	Inch S From	ize To	Rating Sch./Thk.	End	Tag No. & Description	Main Material	
			800#	sw	BA-3A11 (Floating Ball, Full Bore)		
	1/2"	1 1/2"	300#	Flanged, RF	BA-3A12 (Floating Ball, Full Bore)		
	2"	4"	300#	Flanged, RF	BA-3A13 (Floating Ball, Full Bore)		
Ball Valve	2" 4"	300#	Flanged,	BA-3A14 (Trunnion Mounted, Full Bore& /W Gear Operator	(Note 1)		
		300#	Flanged, RF	BA-3A15 (Floating Ball, Reduced Bore)			
	6"	8"	300#	Flanged,	BA-3A16 (Trunnion Mounted, Reduced Bore& /W Gear Operator		
			800#	SW	GA-3A11 (Wedge Gate)		
0.1	1/2"	1 1/2"	300#	Flanged, RF	GA-3A12 (Wedge Gate)		
Gate Valve	2"	8"	300#	Flanged, RF	GA-3A13 (Wedge Gate)	(Note 1)	
	2"	8"	300#	Flanged, RF	GA-3A14 (Flat Gate)		
	1/2"	1 1/2"	300#	Flanged, RF	GL-3A11 (Swivel Type Plug)		
Globe Valve	2"	6"	300#	Flanged, RF	GL-3A12 (Swivel Type Plug & Renewable Seat)	(Note 1)	
	8"	300#	Flanged, RF	GL-3A13 (Swivel Type Plug & Renewable Seat With Gear Operator)			



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 48 of 61	

3A1	Piping	Piping Material Specification					
Service	See A	ppendix A	4		Corrosion Allowance	1 mm	
Rating	300 #				Piping Material	C.S.	
PWHT	NONE						
Pressure-	Гетрега	ture Rati	ng		ASME B16.5		
Design Parameter	2.2Mp	a @ 100°	°C				
Items	Inch S From	ize To	Rating Sch./Thk.	End	Tag No. & Description	Main Material	
Check	1/2"	1 1/2"	300#	Flanged,	CK-3A11 (Lift)		
Valve	2"	8"	300#	Flanged, RF	CK-3A12 (Wafer)	(Note 1)	
	1/2"	1 1/2"	SCH80	PE	Seamless, Steel Pipe		
	2"	2"	SCH80	BE	Seamless, Steel Pipe	ASTM A106 Gr.B To	
Pipe	3"	6"	SCH40	BE	Seamless, Steel Pipe	ASME B36.10 (Note 2)	
	8"	8"	SCH30	BE	Seamless, Steel Pipe		
	1/2"	1 1/2"	SCH160	PE xMNPT	Seamless, Steel Pipe (80mm Long)	ASTM A106 Gr.B To	
Nipple	1/2"	1 1/2"	SCH160	MNPT xMNPT	Seamless, Steel Pipe (80mm Long)	ASME B36.10	
	1/2"	1 1/2"	3000#	SW	Elbow, Tee, Cap, Swage Nipple	ASTM A234 Gr.WPB To ASME B16.11 & MSS SP-95 (Note 3)	
	1/2"	1 1/2"	3000#	NPT	Сар	ASTM A234 Gr.WPB To ASME B16.11 (Note 4)	
Fittings	1/2"	1 1/2"	3000#	sw	Sockolets	ASTM A105 To MSS SP-97 (Note 3)	
	2"	2"	SCH80	BW	Elbow (LR), Tee,	4 OTM 4 OO 4 O M/DD T	
	3"	6"	SCH40	BW	Reducing Tee,	ASTM A234 Gr.WPB To	
	8"	8"	SCH30	BW	Reducer, Cap	ASME B16.9 (Note 5)	
	2"	2"	SCH80	BW		AOTM A 405 T 1400	
	3"	6"	SCH40	BW	Weldolets	ASTM A105 To MSS	
	8"	8"	SCH30	BW		SP-97 (Note 5)	
	1/2"	1 1/2"	300#	SW/RF	Socket Welding (Note 5)	ASTM A105 To ASME B16.5	
Flanges	2"	8"	300#	Flanged,	Welding Neck (Note 5)	ASTM A105 To ASME B16.5	
	1/2"	8"	300#	Flanged,	Blind	ASTM A105 To ASME B16.5	



Job No.	243007D0796		
Doc. No.	MP00S11		
Phase	DETAILED DESIGN		
Rev.	0	Page 49 of 61	

3A1	Piping Material Specification							
Service	See Appendix A				Corrosion Allowance	1 mm		
Rating	300 #				Piping Material	C.S.		
PWHT	NONE							
Pressure-T	empera	ture Rati	ng		ASME B16.5			
Design Parameter	2.2Mpa @ 100°C							
Items	Inch Size Rating End Sch./Thk.		Tag No. & Description	Main Material				
	1/2"	8"	300#	RF	Spectacle Blank	ASTM A105 To ASME B16.48		
	2"	8"	300#	Flanged, RF	Orifice Flange Set	ASTM A105 To ASME B16.36		
Studs/ Nuts	1/2"	8"	300#	N/A	Full Length, /W Two HVY Hexagonal Nuts To ASME B16.5 /B18.31.2 /B18.2.2	Stud Bolts Alloy Steel ASTM A193-B7/ 194-2H Hot Dip Galvanized To ASTM A153		
Gasket	1/2"	8"	300#	RF	Spirally Wound /W Inner & Outer Rings	SS 316L/FG 4.5mm Thk OR/IR:316L To ASME B16.20		

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Bevelled end as per ASME B16.25.
- 3. Socket weld shall be as per ASME B16.11.
- 4. Threaded end as per ASME B1.20.1.
- 5. Thickness to suit pipe.



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAIL	ED DESIGN		
Rev.	0	Page 50 of 61		

3C0	Piping Material Specification						
Service	See A	ppendix	A		Corrosion Allowance	0 mm	
Rating	300 #				Piping Material	ASTM A312-TP316L	
PWHT	NONE						
Pressure-T	empera	ture Rat	ing		ASME B16.5		
Design Parameter	1.5Mpa @ 85°C						
Items	Inch S From	ize To	Rating Sch./Thk.	End	Tag No. & Description	Main Material	
	1/2"	1 1/2"	300#	Flanged,	BA-3C01 (Floating Ball, Full Bore)		
	2"	4"	300#	Flanged, RF	BA-3C02 (Floating Ball, Full Bore)		
Ball Valve	6"	6"	300#	Flanged,	BA-3C03 (Trunnion Mounted, Full Bore& /W Gear Operator	(Note 1)	
	2"	4"	300#	Flanged, RF	BA-3C04 (Floating Ball, Reduced Bore)		
	6"	6"	300#	Flanged,	BA-3C05 (Trunnion Mounted, Reduced Bore& /W Gear Operator		
Gate	1/2"	1 1/2"	300#	Flanged, RF	GA-3C01 (Wedge Gate)		
Valve	2"	6"	300#	Flanged, RF	GA-3C02 (Wedge Gate)	(Note 1)	
0	1/2"	1 1/2"	300#	Flanged, RF	GL-3C01 (Swivel Type Plug)		
Globe Valve	2"	6"	300#	Flanged,	GL-3C02 (Swivel Type Plug & Renewable Seat)	(Note 1)	
Check	1/2"	1 1/2"	300#	Flanged, RF	CK-3C01 (Lift)	(1)	
Valve	2"	6"	300#	Flanged, RF	CK-3C02 (Wafer)	(Note 1)	
Dine	1/2"	1 1/2"	SCH80S	PE	Seamless, Steel Pipe	ASTM A312-TP316L To	
Pipe	2"	6"	SCH40S	BE	Seamless, Steel Pipe	ASME B36.19 (Note 2)	
Nipple	1/2"	1 1/2"	SCH160	PE xMNPT	Seamless, Steel Pipe (80mm Long)	ASTM A312-TP316L To ASME B36.10	



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 51 of 61		

3C0	Piping Material Specification						
Service	See A	ppendix .	A		Corrosion Allowance	0 mm	
Rating	300 #				Piping Material	ASTM A312-TP316L	
PWHT	NONE						
Pressure-	Tempera	ture Rat	ing		ASME B16.5		
Design Parameter	1.5Mpa	a @ 85°0	С				
Items	Inch Size Rating From To Sch./Thk.			End	Tag No. & Description	Main Material	
	1/2"	1 1/2"	SCH160	MNPT xMNPT	Seamless, Steel Pipe (80mm Long)		
	1/2"	1 1/2"	3000#	sw	Elbow, Tee, Cap, Swage Nipple	ASTM A403 WP316L-S To ASME B16.11 & MSS SP-95 (Note 3)	
	1/2"	1 1/2"	3000#	NPT	Сар	ASTM A403 WP316L-S To ASME B16.11 (Note 4)	
Fittings	1/2"	1 1/2"	3000#	SW	Sockolets	ASTM A182-F316L To MSS SP-97 (Note 3)	
	2"	6"	SCH40S	BW	Elbow (LR), Tee, Reducing Tee, Reducer, Cap	ASTM A403 WP316L-S To ASME B16.9 (Note 5)	
	2"	6"	SCH40S	BW	Weldolets	ASTM A182-F316L To MSS SP-97 (Note 5)	
	1/2"	1 1/2"	300#	SW/RF	Socket Welding (Note 5)	ASTM A182-F316L To ASME B16.5	
	2"	6"	300#	Flanged, RF	Welding Neck (Note 5)	ASTM A182-F316L To ASME B16.5	
Flanges	1/2"	6"	300#	Flanged, RF	Blind	ASTM A182-F316L To ASME B16.5	
	1/2"	6"	300#	RF	Spectacle Blank	ASTM A182-F316L To ASME B16.48	
	2"	6"	300#	Flanged, RF	Orifice Flange Set	ASTM A182-F316L To ASME B18.36	
Studs/ Nuts	1/2"	6"	300#	N/A	Full Length, /W Two HVY Hexagonal Nuts To ASME B16.5/ B18.31.2 /B18.2.2	Stud Bolts Alloy Steel ASTM A193-B7M/ A194-2HM XYLAN Fluoropolymer Coated	
Gasket	1/2"	6"	300#	RF	Spirally Wound /W Inner & Outer Rings	SS 316L/RPTFE 4.5mm Thk OR/IR:316L To ASME B16.20	



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAIL	ED DESIGN		
Rev.	0 Page 52 of 61			

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Bevelled end as per ASME B16.25.
- 3. Socket weld shall be as per ASME B16.11.
- 4. Threaded end as per ASME B1.20.1.
- 5. Thickness to suit pipe.



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAIL	ED DESIGN		
Rev.	0	Page 53 of 61		

15N0	Piping Material Specification						
Service	See A	ppendix .	A		Corrosion Allowance	0 mm	
Rating	1500 #	<b>‡</b>			Piping Material	ASTM A790-S31803	
PWHT	NONE						
Design Parameter	25Mpa	a @ 99°C	;				
	Inch S	ize	Rating		T N 05 ''		
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material	
Ball Valve	1/2"	1 1/2"	1500#	Flanged,	BA-15N01(Floating Ball, Full Bore)	(Note 1)	
	1/2"	1 1/2"	1500#	Flanged,	GA-15N01 (Solid Wedge Type)		
Gate	2"	3"	1500#	Flanged,	GA-15N02 (Flexible Wedge Type)	(Note 1)	
Valve	4"	18"	1500#	Flanged,	GA-15N03 (Flexible Wedge Type & /W Gear Operator)		
	1/2"	1 1/2"	1500#	Flanged, RJ	GL-15N01 (Swivel Type Plug)	_ _ (Note 1)	
Globe	2"	4"	1500#	Flanged, RJ	GL-15N02 (Swivel Type Plug)		
Valve	6"	8"	1500#	Flanged,	GL-15N03 (Swivel Type Plug With Gear Operator)		
	1/2"	1 1/2"	1500#	Flanged,	CK-15N01 (Lift)		
	2"	3"	1500#	Flanged,	CK-15N02 (Tilting)		
Check Valve	4"	18"	1500#	Flanged,	CK-15N03 (Tilting)	(Note 1)	
	2"	3"	1500#	Flanged,	CK-15N04 (Swing)		
	4"	18"	1500#	Flanged,	CK-15N05 (Swing)		
	1/2"	1 1/2"	3.68mm	BE	Seamless, Duplex Stainless Pipe	ASTM A790-S31803 To	
Pipe	2"	2"	4.78mm	BE	Seamless, Duplex Stainless Pipe	ASME B36.19/ ASME B36.10 (Note 2)	



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAILED DESIGN			
Rev.	0	Page 54 of 61		

15N0	Piping	Piping Material Specification					
Service	See A	ppendix <i>i</i>	A		Corrosion Allowance	0 mm	
Rating	1500 #	ŧ			Piping Material	ASTM A790-S31803	
PWHT	NONE						
Design Parameter	25Mpa @ 99°C						
.,	Inch S	ize	Rating		T N 05 ''		
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material	
	3"	3"	7.14mm	BE	Seamless, Duplex Stainless Pipe		
	4"	4"	11.13mm	BE	Seamless, Duplex Stainless Pipe		
	6"	6"	12.7mm	BE	Seamless, Duplex Stainless Pipe		
	8"	8"	18.26mm	BE	Seamless, Duplex Stainless Pipe		
	10"	10"	20.62mm	BE	Seamless, Duplex Stainless Pipe		
	12"	12"	25.4mm	BE	Seamless, Duplex Stainless Pipe		
	14"	14"	27.79mm	BE	EFW, Duplex Stainless Pipe	AOTNA A000 004000	
	16"	16"	30.96mm	BE	EFW, Duplex Stainless Pipe	ASTM A928-S31803 CLASS 1 Welded To ASME B36.10	
	18"	18"	34.93mm	BE	EFW, Duplex Stainless Pipe		
Nimala	1/2"	1 1/2"	SCH160	BExMNPT	Seamless, Duplex Stainless Pipe (80mm Long)	ASTM A790-S31803 To	
Nipple	1/2"	1 1/2"	SCH160	MNPT xMNPT	Seamless, Duplex Stainless Pipe (80mm Long)	ASME B36.10	
	1/2"	1 1/2"	3.68mm	BW			
	2"	2"	4.78mm	BW			
	3"	3"	7.14mm	BW			
	4"	4"	11.13mm	BW	Elbow (LR), Tee,	ASTM A815-S31803	
Fittings	6"	6"	12.7mm	BW	Reducer, Cap	WP-S To ASME B16.9	
	8"	8"	18.26mm	BW		(Note 3)	
	10"	10"	20.62mm	BW			
	12	12	25.4mm	BW			



Job No.	243007D0796			
Doc. No.	MP00S11			
Phase	DETAIL	ED DESIGN		
Rev.	0	Page 55 of 61		

15N0	Piping Material Specification							
Service	See A	pendix <i>i</i>	Ą		Corrosion Allowance	0 mm		
Rating	1500 #	ŧ			Piping Material	ASTM A790-S31803		
PWHT	NONE							
Design Parameter	25Mpa	ı @ 99°C	;					
14	Inch S	ize	Rating		To a No. O December 1	Martin Martin La		
Items	From	То	Sch./Thk.	End	Tag No. & Description	Main Material		
	14"	14"	27.79mm	BW	- \A/	ASTM A815-S31803		
	16"	16"	30.96mm	BW	Welded, Elbow (LR),	WP-WX To ASME B16.9		
	18"	18"	34.93mm	BW	Tee, Reducer, Cap	(Note 3)		
	1/2"	1 1/2"	3.68mm	BW				
	2"	2"	4.78mm	BW		ASTM A182-F51 To		
	3"	3"	7.14mm	BW	Weldolets			
	4"	4"	11.13mm	BW		MSS SP-97 (Note 3)		
	6"	6"	12.7mm	BW				
	8"	8"	18.26mm	BW				
	1/2"	18"	1500#	Flanged, RJ	Welding Neck (Note 3)	ASTM A182-F51 To		
	1/2"	18"	1500#	Flanged, RJ	Blind	ASME B16.5		
Flanges	1/2"	4"	1500#	RJ	Spectacle Blank	ASTM A182-F51 To		
	6"	18"	1500#	RJ	Blinds and Spacer	ASME B16.48		
	2"	18"	1500#	Flanged,	Orifice Flange Set	ASTM A182-F51 To ASME B16.36		
					Full Length, /W Two	Stud Bolts Alloy Steel		
Studs/					HVY Hexagonal Nuts	ASTM A193-B7M/		
Nuts	1/2"	18"	1500#	N/A	To ASME B16.5/	A194-2HM XYLAN		
					B18.31.2 /B18.2.2	Fluoropolymer Coated		
Gasket	1/2"	18"	1500#	RJ	Octagonal Ring Type	S31803 To ASME B16.20		

- 1. For details, see CMIT-230084-1-796-PIP-15.03-00-2010\_SPECIFICATION FOR MANUAL VALVES.
- 2. Bevelled end as per ASME B16.25.
- 3. Thickness to suit pipe.



Job No.	243007D0796							
Doc. No.	MP00S11							
Phase	DETAIL	ED DESIGN						
Rev.	0	Page 56 of 61						

### **APPENDIX C**

**BRANCH CONNECTIONS** 



Job No.	243007D0796							
Doc. No.	MP00S	311						
Phase	DETAIL	_ED DESIGN						
Rev.	0	Page 57 of 61						

### BRANCH CONNECTION TABLE 1 Piping class 1A1, 3A1, 1C0, 3C0

	Brar	nch Pi	ре														
Main-Header		1/2	3/4	1	1	2	3	4	6	8	10	12	14	16	18	20	24
					1/2												
	1/2	Т															
	3/4	RT	Т														
	1	RT	RT	Т													
	1	RT	RT	RT	Т												
	1/2																
	2	so	so	TSN	TSN	Т											
	3	so	so	so	TSN	RT	Т										
	4	so	so	so	so	RT	RT	Т									
	6	so	so	so	so	WO	RT	RT	Т								
	8	so	so	so	so	WO	wo	RT	RT	Т							
	10	so	so	so	so	WO	wo	RT	RT	RT	Т						
	12	so	so	so	so	WO	wo	wo	RT	RT	RT	Т					
	14	so	so	so	so	WO	wo	wo	RT	RT	RT	RT	Т				
	16	so	so	so	so	WO	wo	WO	RT	RT	RT	RT	RT	Т			
	18	so	so	so	so	wo	wo	wo	wo	RT	RT	RT	RT	RT	Т		
	20	so	so	so	so	WO	wo	wo	wo	RT	RT	RT	RT	RT	RT	Т	

Notes: T - Straight Tee

RT - Reducing Tee

SO - Sockolets

WO - Weldolets

TSN – Tee or Reducing Tee with Swaged Nipple

1) Any deviation from the connection type shown in the above table or branch connections for larger piping sizes shall be approved in writing by COMPANY.



Job No.	243007D0796							
Doc. No.	MP00S	311						
Phase	DETAIL	ED DESIGN						
Rev.	0	Page 58 of 61						

### BRANCH CONNECTION TABLE 2 Piping class 1A3, 1A4, 1D3, 1N0, 15N0

	Brar	nch Pip	е		_												
Main-Header		1/2	3/4	1	1	2	3	4	6	8	10	12	14	16	18	20	24
					1/2												
	1/2	Т															
	3/4	RT	Т														
	1	RT	RT	Т													
	1	RT	RT	RT	Т												
	1/2																
	2	WO	WO	RT	RT	Т											
	3	WO	WO	WO	RT	RT	Т										
	4	wo	WO	wo	wo	RT	RT	Т									
	6	wo	wo	WO	wo	wo	RT	RT	Т								
	8	wo	wo	wo	wo	wo	wo	RT	RT	Т							
	10	wo	wo	wo	wo	wo	wo	RT	RT	RT	Т						
	12	wo	WO	wo	wo	wo	wo	wo	RT	RT	RT	Т					
	14	wo	wo	wo	wo	wo	wo	wo	RT	RT	RT	RT	Т				
	16	wo	WO	wo	wo	wo	wo	WO	RT	RT	RT	RT	RT	Т			
	18	wo	WO	wo	wo	wo	wo	WO	WO	RT	RT	RT	RT	RT	Т		
	20	wo	WO	wo	wo	wo	wo	WO	WO	RT	RT	RT	RT	RT	RT	Т	

Notes: T - Straight Tee

RT - Reducing Tee

WO - Weldolets

1) Any deviation from the connection type shown in the above table or branch connections for larger piping sizes shall be approved in writing by COMPANY.



Job No.	243007D0796							
Doc. No.	MP00S	11						
Phase	DETAIL	ED DESIGN						
Rev.	Page 59 of 61							

## BRANCH CONNECTION TABLE 3 – PIPING CLASS 1G0

			В	RANC	Н		
	inches	3/4	1	1 1/2	2	3	4
	3/4	Т					
H	1	RT	Т				
A	1 1/2	RT	RT	Т			
D E	2	RT	RT	RT	Т		
R	3	TSN	TSN	RT	RT	Т	
	4	TSN	TSN	RT	RT	RT	Т

Notes: T - Straight Tee Threaded

RT - Reducing Tee Threaded

TSN - Tee or Reducing Tee with Swaged Nipple

- 1) All branch connections shall be designed and reinforced so that the branch line connection is equal to the pressure and temperature rating of the header.
- 2) Any deviation from the connection type shown in the above table or branch connections for larger piping sizes shall be approved in writing by COMPANY.



Job No.	Job No. 243007D0796							
Doc. No.	MP00S	311						
Phase	DETAIL	ED DESIGN						
Rev.	0	Page 60 of 61						

#### APPENDIX D

**REDUCING CONNECTIONS** 



Job No.	243007D0796								
Doc. No.	MP00S	MP00S11							
Phase	DETAIL	ED DESIGN							
Rev.	0	Page 61 of 61							

	Main-H	Header													
Branc		3/4	1	1 1/2	2	3	4	6	8	10	12	14	16	18	20
h Pipe	1/2	SNP	SNP	SNP											
	3/4		SNP	SNP	SNP										
	1			SNP	SNP										
	1 1/2				SNP	SNP	SNP								
						+R	+R								
	2					R	R								
	3						R	R							
	4							R	R	R					
	6								R	R	R	R			
	8									R	R	R	R		
	10										R	R	R	R	
	12											R	R	R	R
	14												R	R	R
	16													R	R
	18														R
	20														

Notes: SNP - Swaged Nipple

R - Reducer

SNP+R - Swaged Nipple with Reducer (When the branch pipe size is below 2", the large end of the swaged nipple is 2".)